


# Dana për zhveshjen e kablllove, izoluar

478/1VDEBI

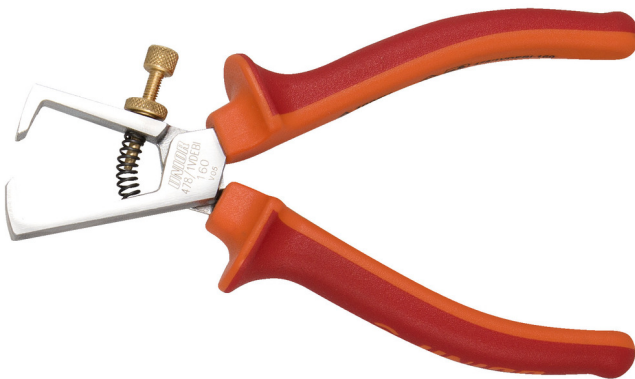

## Profiles

---




## Standards

---

DIN EN IEC 60900 (VDE 0682-201):2019-04; EN IEC 60900:2018

## Product features


- Materiali: çeliku të veçantë mjet
- rënie të falsifikuara, ngurtësuar tërësisht dhe nevrík
- prerja tehe induksion thekur
- kreu i lëmuar
- përfundojë sipërfaqe: krom kromuar për ISO 1456:2009 standarde
- të rënda në detyrë të dyfishtë - komponent trajton
- nxjerrje kapacitet: deri në maksimum 0.6 - 10MM<sup>2</sup>
- pranverës për rihapjen
- bërë sipas standardit EN IEC 60900

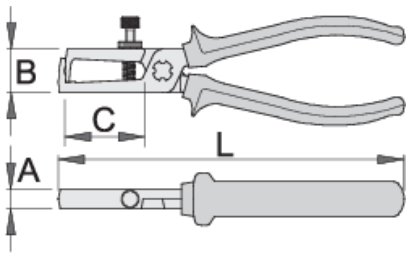

	<b>L</b>		<b>B</b>	<b>A</b>	<b>C</b>	
610433	160	0.6 - 10	18	9	40	178

\* Imazhet e produkteve janë simbolike. Të gjitha dimensionet janë në mm, pesha në gram. Të gjitha dimensionet e listuara mund të ndryshojnë në tolerancë.

## Usage (pictures)

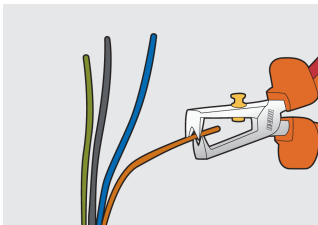

## Frequently asked questions

### **Are certified insulated tools made through a different procedure than non-certified insulated tools?**

The tools are made according to the same procedure.

### **Are insulated (VDE) tools considered as personal protective equipment (PPE)?**

According to EU regulations, VDE tools are not considered as PPE.

### **Is it possible to work with insulated pliers under electrical voltage?**

Yes, but only by professionals who follow safety requirements and use additional personal protective equipment.

### **Are the VDE tools only being sampled in series production?**

The high voltage test (at 10kV) is performed fully on each tool. Other tests are performed in accordance with the EN60900 standard.